





CONCENTRICITY GAUGES


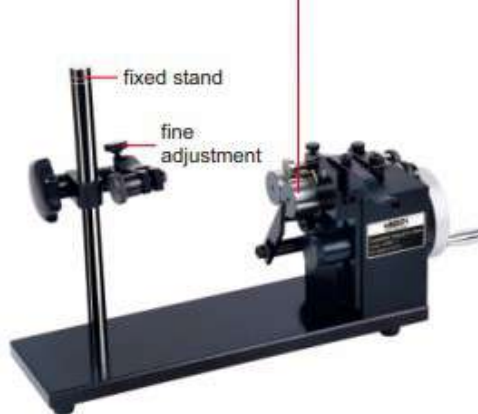


4789-1E

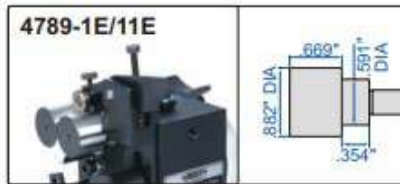

4789-21E

to ensure the accuracy .00008", the distance between measuring point and roller should be <1.181"

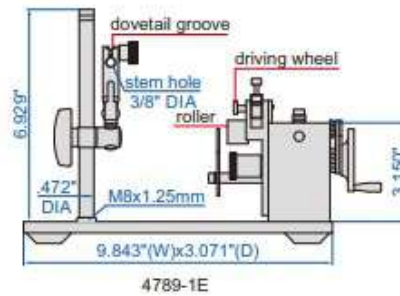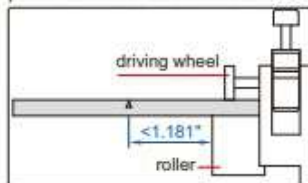

- Accuracy .00008"
- Optional accessory: dial test indicator

Part No.	Applicable diameter	Remark
4789-1E	.138" DIA~.984" DIA	fixed stand, good rigidity
4789-2E	.039" DIA~.984" DIA	fixed stand, good rigidity
4789-3E	.039" DIA~.984" DIA	fixed stand, good rigidity
4789-11E	.138" DIA~.984" DIA	universal stand, convenient operation
4789-21E	.039" DIA~.984" DIA	universal stand, convenient operation
4789-31E	.039" DIA~.984" DIA	universal stand, convenient operation